

# onsite

## HV SOLUTIONS

### CONDITION BASED MAINTENANCE

Recommendation for condition assessment of service aged XLPE insulated transmission power cables



## Background

Remaining Life Management of power cables deals with a complex issue, consisting of a combination of technical, strategic and economic factors. The process of natural ageing strongly depends on the operating mode of the cable system (nominal load or partial load, continuous or short time operation, overloads, number of starts, standstill periods).

The XLPE insulation degradation strongly depends on the service conditions such as: load, number and type of defects developed during years of service, repair quality and an environmental factor e.g. soil thermal resistivity, over-voltage conditions.

Ageing failures indirectly are the result of cable service stresses. Four major cable stresses so called TEAM factors can be specified:

- Thermal stresses
- Electrical stresses
- Ambient stresses
- Mechanical stresses

Breakdown traces on the field steering body of a 110 kV cable




## Insulation Aging

Three types of degradations can describe degradation of XLPE insulation:

- Chemical degradation of insulation and trapped charges
- Physical degradation (irreversible changes in dielectric structure)
- Electrical degradation (tracking, electric treeing)

Solid dielectric insulated cables are not affected by thermal ageing at normal operating maximum temperature, below 90 °C. Gasification can occur when XLPE insulation is operated above 130 °C, but it will not intrinsically affect the breakdown strength. The effects of the temperature are considered when operating XLPE insulation at high temperatures and are subjected to thermal cycling (thermo-mechanical stresses).

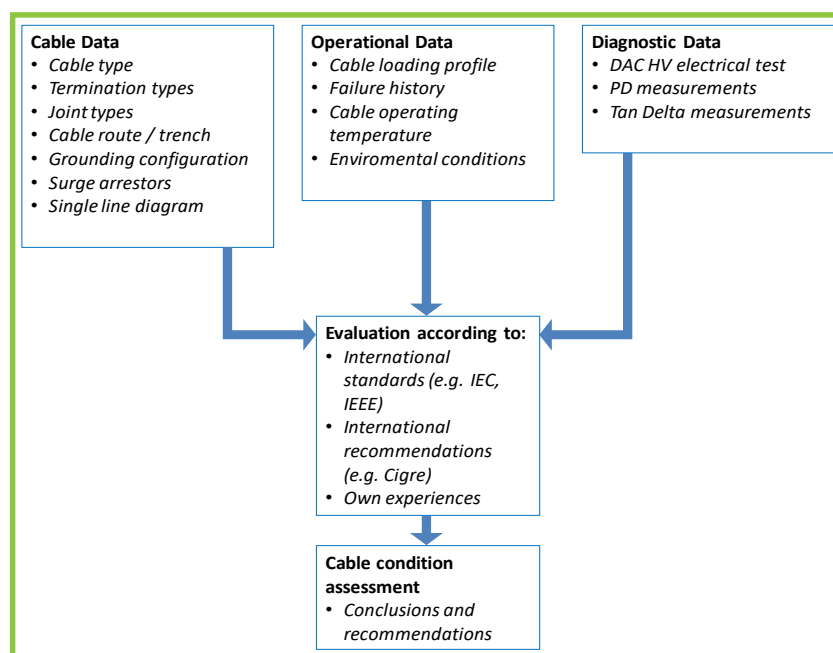

Cable condition assessment approach

## Cable Condition Assessment Approach

To obtain the overall technical condition of the cable circuits and to evaluate the ageing factors for XLPE insulated cables (as far as detectable with electrical tests) the following diagnostic test will be performed and the results evaluated in relation to international guidelines [1-5] :

- High voltage damped AC testing (DAC)
- Partial discharge (PD) measurement with localization
- Dielectric losses by the Dissipation Factor ( $\tan \delta$ )

## Damped AC Insulation Condition Evaluation

Damped AC (DAC) technology has the advantage of non-destructive testing and the method provides deterministic values of partial discharge (PD) activities in the cable system as well as the Dissipation Factor ( $\tan \delta$ ) of the overall cable system.

The overall cable condition evaluation is performed by:


**Condition Based Maintenance (CBM):** DAC HV tests and diagnosis and the evaluation of diagnostic parameters

**Cable condition index:** Partial discharge values and the PD evaluation together with the Dissipation Factor ( $\tan \delta$ ) are evaluated according to knowledge rules and statistical evaluation to obtain an overall condition index

**Future Life Estimation (FLE):** Diagnosing the life consumption and future life estimation of Paper-oil insulated cable is based on thermal ageing and the diagnostic parameters ( $\tan \delta$  and PD).

### Cable Condition Index

The measured Dissipation Factor ( $\tan \delta$ ) are used as input for statistical analysis to obtain  $\tan \delta$  boundary values for a particular type of cable insulation.

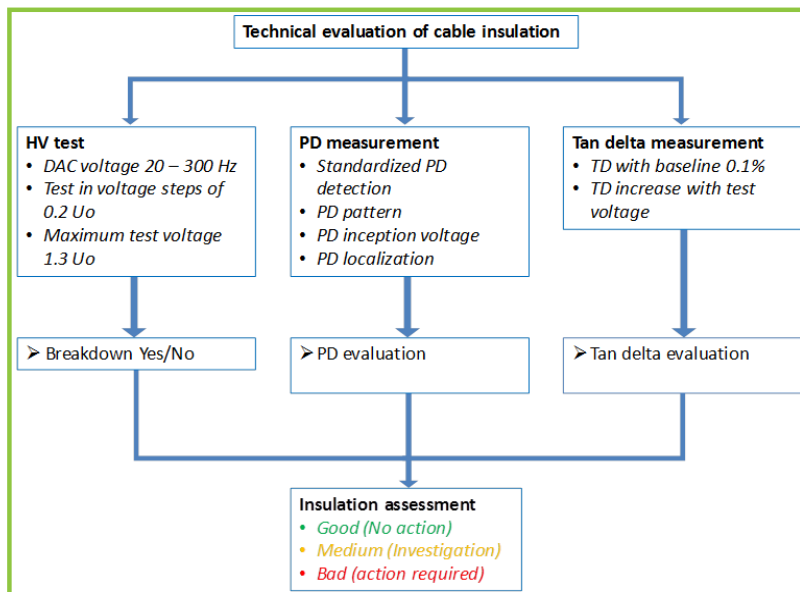

These boundary values can be used for cable condition indexing. To obtain these values the fitted statistical distribution of  $\tan \delta$  values from measurements on comparable cable types are evaluated. The boundary values are used to provide a condition index (CI) that is indicated with number and color:

- Index 9:** very good (green)
- Index 8:** good (light green)
- Index 6:** moderate (yellow)
- Index 3:** poor (orange)
- Index 1:** very poor (red)

### Damped AC cable insulation condition assessment


For each phase of a cable circuit at the different voltage levels the condition indexing can be obtained for the measured values. Eventually these values are combined to obtain an overall condition index per phase.

Condition parameter	Phase		
	L1	L2	L3
Concentrated PD	9	6	1
PDIV $\leq U_0$	9	9	1
PD amplitude at PDIV	9	6	3
TD evaluation	8	8	8
<b>Overall cable rating</b>	<b>9</b>	<b>8</b>	<b>3</b>

Example of statistically obtained condition indices for the PD and  $\tan \delta$  evaluation for the condition indexing levels for a XLPE 220 kV cable

## Future Life Estimation

As XLPE insulation is not sensitive to thermal ageing, as long as the maximum conductor temperature is not exceeded, this parameter does not play a role in the life consumption, which is the case of fluid-filled cable systems.

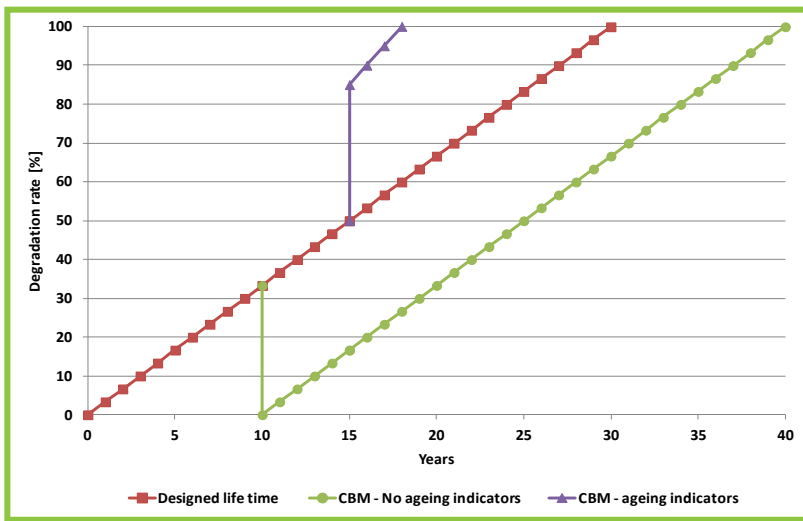

Mainly the ageing of XLPE insulation is more dependent on local defects and/or their degradation due to above mentioned TEAM factors in cable insulation or cable accessories that can be represented by partial discharges and dielectric losses [1-5].

Example of future life estimation based on a technical lifetime of 30 years. At the moment CBM is performed, the FLE is adjusted based on the diagnostic parameters

## Conclusions

- The application of damped AC technology (DAC) with on-site diagnosis of transmission power cables with XLPE insulation provides the essential information to evaluate your cable condition [1-5].
- Interpreting PD occurrence in combination with dielectric losses are an adequate method to get insight into discharging insulation defects in XLPE insulated cables.
- The diagnostic information as obtained using onsite DAC testing and diagnosis contributes in the overall cable condition assessment.
- The obtained experiences in the past years provided the information to develop our own specific knowledge rules to support maintenance and replacement activities of XLPE transmission power cables.

## References

1. Cigré Technical Brochure 420: Generic Guidelines for Life Time Condition Assessment of HV Assets and Related Knowledge Rules 2010
2. IEEE 400: Guide for Field Testing and Evaluation of the Insulation of Shielded Power Cable Systems Rated 5 kV and Above
3. IEEE 400.4: Guide for Field-Testing of Shielded Power Cable Systems Rated 5 kV and Above with Damped Alternating Current Voltage (DAC)
4. IEEE Transactions on Power Delivery: Condition Based Maintenance of Transmission Power Cables, vol. 37, no. 3, pp. 1588-1597, June 2022
5. Cigre Science and Engineering: Testing and Diagnosis of Power Cables using Damped AC Voltages, Cigre Science and Engineering, CSE no. 29, June 2023.

### onsite hv solutions ag

Töpferstrasse 5

6004 Lucerne

Switzerland

Member of *Electrosuisse*

Phone: +41 41 500 0550

Fax: +41 41 500 0551

### onsite hv solutions Benelux B.V.

Van der Kunstraat 10

4251 LN Werkendam

The Netherlands

Phone: +31 183 304 012

Fax: +31 183 302 008

### onsite hv solutions Central Europe Sp. z o. o.

Bagatela 11, lok. 14

00-585 Warsaw

Poland

Phone: +48 693 491 444

Fax: +48 895 264 485

### MasterGrid

2 rue de la Neva

38000 Grenoble

France

Phone: +33 4 56 59 35 12

Email: [clients@mastergrid.com](mailto:clients@mastergrid.com)

Web: [www.mastergrid.com](http://www.mastergrid.com)

Email: [info@onsitehv.com](mailto:info@onsitehv.com)

Web: [www.onsitehv.com](http://www.onsitehv.com)

Member of **Onsite HV Group**

**onsite**  
HV SOLUTIONS